

AUG 14 1968

BUILDING SCIENCE SERIES

14

Reference book not to be
taken from the library.



Experimental Determination Of Eccentricity of Floor Loads Applied to a Bearing Wall



U.S. DEPARTMENT OF COMMERCE
National Bureau of Standards

Announcing—The Building Science Series

The "Building Science Series" disseminates technical information developed at the Bureau on building materials, components, systems, and whole structures. The series presents research results, test methods, and performance criteria related to the structural and environmental functions and the durability and safety characteristics of building elements and systems.

These publications, similar in style and content to the NBS Building Materials and Structure Reports (1938–59), are directed toward the manufacturing, design, and construction segments of the building industry, standards organizations, officials responsible for building codes, and scientists and engineers concerned with the properties of building materials.

The material for this series originates principally in the Building Research Division of the NBS Institute for Applied Technology. Published or in preparation are:

- BSS1. Building Research at the National Bureau of Standards. (In preparation.)
- BSS2. Interrelations Between Cement and Concrete Properties: Part 1, Materials and Techniques, Water Requirements and Trace Elements. 35 cents
- BSS3. Doors as Barriers to Fire and Smoke. 15 cents
- BSS4. Weather Resistance of Porcelain Enamels: Effect of Exposure Site and other Variables After Seven Years. 20 cents
- BSS5. Interrelations Between Cement and Concrete Properties: Part 2, Sulfate Expansion, Heat of Hydration, and Autoclave Expansion. 35 cents
- BSS6. Some Properties of the Calcium Aluminoferrite Hydrates. 20 cents
- BSS7. Organic Coatings. Properties, Selection, and Use. \$2.50
- BSS8. Interrelations Between Cement and Concrete Properties: Part 3, Compressive Strengths of Portland Cement Test Mortars and Steam-Cured Mortars. 55 cents
- BSS9. Thermal-Shock Resistance for Built-Up Membranes. 20 cents
- BSS10. Field Burnout Tests of Apartment Dwelling Units. 25 cents
- BSS11. Fire Resistance of Steel Deck Floor Assemblies. 25 cents
- BSS12. Performance of Square-Edged Orifices and Orifice-Target Combinations as Air Mixers. 15 cents
- BSS13. Shrinkage and Creep in Prestressed Concrete. 15 cents

Send orders with remittance to: Superintendent of Documents, U.S. Government Printing Office, Washington, D.C. 20402. Remittances from foreign countries should include an additional one-fourth of the purchase price for postage.

UNITED STATES DEPARTMENT OF COMMERCE • C. R. Smith, *Secretary*

NATIONAL BUREAU OF STANDARDS • A. V. Astin, *Director*

Experimental Determination of Eccentricity of Floor Loads Applied to a Bearing Wall

D. Watstein and P. V. Johnson

Building Research Division
Institute for Applied Technology
National Bureau of Standards
Washington, D.C.



Building Science Series 14

Issued June 1968

CONTENTS

	Page
1. Introduction.....	1
2. Description of the compressive steel reaction strut for measurement of eccentricities, and its calibration.....	1
3. Eccentricity of reaction of an I-beam bedded in gypsum plaster....	3
4. Eccentricity of reaction of an I-beam supported on neoprene rubber..	4
5. Eccentricity of supporting force at the base of a bearing wall sub- jected to an eccentrically applied load.....	4
6. Summary.....	5

Experimental Determination of Eccentricity of Floor Loads Applied to a Bearing Wall

D. Watstein* and P. V. Johnson*

The eccentricity of the loads applied to a specially calibrated compressive strut simulating a brick bearing wall was experimentally determined for a variety of bearing materials and conditions of contact. In one series of tests, an I-beam was bedded in high strength gypsum plaster, bonded and unbonded. For the unbonded plaster bed the eccentricity ratio¹ increased with the applied load to a maximum value of about 0.42, while for the bonded plaster bearing this ratio decreased to an average value of about 0.24 at the maximum load.

In the second series of tests the eccentricity was observed for an I-beam supported on neoprene rubber pads, capped and uncapped, of different thicknesses, and of different bearing length. In general the eccentricity ratio increased slightly with the applied load. Lack of intimate contact between the I-beam and the rubber pad $\frac{1}{4}$ in thick resulted in an eccentricity ratio of about 0.40, or nearly the same as for unbonded plaster bearing. Intimacy of contact produced by plaster capping resulted in a marked reduction in the eccentricity ratio to about 0.29; the confinement of the bearing length of the rubber pad to one-half of that used in previous tests and placing it at the extreme end of the beam, further reduced the eccentricity ratio to about 0.18, and to 0.13 for a rubber pad 0.25 in thick.

Key words: Bearing pads, bearing walls, brick masonry, design of bearing walls, eccentricity of applied loads.

1. Introduction

Since exterior bearing walls are designed as eccentrically loaded compression members, it is important to know what the eccentricities of the applied floor loads are for different bearing materials and different conditions of contact between the supporting structure and the floor beams. Some recently completed exploratory studies by the Structural Clay Products Institute Research Fellowship at NBS indicated that it is feasible to measure the eccentricities of applied loads using a specially designed stress-sensitive compressive strut calibrated under loads of known eccentricities. The strut was assumed to simulate

a load bearing wall of brick masonry even though the boundary conditions and the elastic properties of the strut were different from those encountered in an actual masonry structure.

The exploratory study included an investigation of such parameters as thickness and rigidity of bearing materials, the intimacy of contact between the supporting structure and the flexural members, and the effect of bond with the bedding material on the eccentricity of the floor loads.

The feasibility of measuring the eccentricity of the force supporting a masonry wall subjected to an eccentrically applied load was also explored.

2. Description of the Compressive Steel Reaction Strut for Measurement of Eccentricities, and Its Calibration

The compressive steel reaction strut was a rectangular steel tube 4 by 8 inches in cross section having a wall 0.187 in thick. The strut was 18 in high and had a $\frac{3}{8}$ -in welded steel plate insert at the top providing a closed end. The strut was capped with a 1- by 4- by 8-in cold-rolled steel plate bonded to the top welded plate insert with epoxy cement. The whole assembly was then capped with a solid extruded clay brick which served to receive the load, simulating the bearing conditions at the top of a brick masonry wall.

The open bottom end was machined normal to the axis of the strut and was supported on a machined steel plate 4 in thick.

The dimensions of the capping brick were $2\frac{1}{4}$ by $3\frac{1}{16}$ by $7\frac{7}{8}$ in and hence the brick did not cover the 1-in steel cap completely. The brick was set flush with one side of the strut (designated as side H) and was centered with respect to the 4-in dimension of the strut as shown in figure 1.

The strut was instrumented with bonded wire strain gages at two different levels. The location of the gages is indicated in figure 1.

*Present address: Structural Clay Products Institute, 1750 Old Meadow Road, McLean, Virginia 22101.

¹ The eccentricity ratio is defined as the ratio of eccentricity to the overall thickness of the strut.

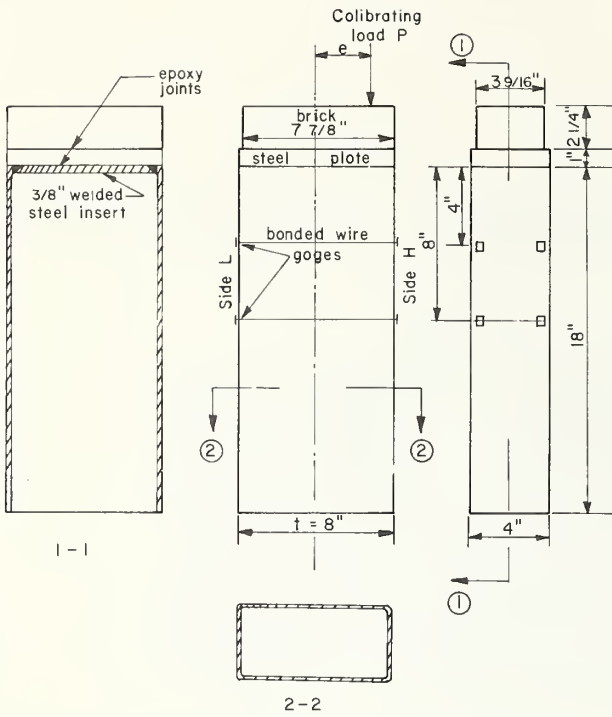


FIGURE 1. Schematic drawing of instrumented reaction strut for measurement of eccentricity of load.

During calibration a load, P , was applied to the strut through a hardened steel knife edge seated in a suitable V block. Thus, the eccentricity of the applied load could be measured with a steel scale with an accuracy of about $1/32$ in.

Let σ_{\max} and σ_{\min} be respectively the stresses on the side of the applied load and the opposite side; then the following expressions can be written:

$$\sigma_{\max} = \frac{P}{A} + \frac{Pec}{Ar^2} = \frac{P}{A} \left[1 + \frac{ec}{r^2} \right] \quad (1)$$

and

$$\sigma_{\min} = \frac{P}{A} - \frac{Pec}{Ar^2} = \frac{P}{A} \left[1 - \frac{ec}{r^2} \right] \quad (2)$$

where

A = the cross section area of the strut, in.²,
 c = distance from the neutral axis to the outermost fiber, inches,
 r = radius of gyration, inches. (Ar^2 = moment of inertia of the section), and
 e = eccentricity of applied load, in.

Adding (1) and (2),

$$\sigma_{\max} + \sigma_{\min} = \frac{2P}{A} \quad (3)$$

Subtracting (2) from (1),

$$\sigma_{\max} - \sigma_{\min} = \frac{2Pec}{Ar^2} \quad (4)$$

Dividing (4) by (3),

$$\frac{\sigma_{\max} - \sigma_{\min}}{\sigma_{\max} + \sigma_{\min}} = \frac{ec}{r^2} \quad (5)$$

and solving for e ,

$$e = \frac{r^2}{c} \left[\frac{\sigma_{\max} - \sigma_{\min}}{\sigma_{\max} + \sigma_{\min}} \right]$$

Assuming that the stresses σ_{\max} and σ_{\min} are within the elastic limit, the eccentricity e in terms of strains ϵ_{\max} and ϵ_{\min} is given by:

$$e = \frac{r^2}{c} \left[\frac{\epsilon_{\max} - \epsilon_{\min}}{\epsilon_{\max} + \epsilon_{\min}} \right] \quad (6)$$

For the reaction strut used in these tests, $r^2/c = 2.06$, and (6) becomes

$$e = 2.06 \left(\frac{\epsilon_{\max} - \epsilon_{\min}}{\epsilon_{\max} + \epsilon_{\min}} \right) \quad (7)$$

The theoretical relationship given by (7) and the experimental curve determined in two separate laboratory setups are compared in figure 2. The experimental values of eccentricity e were varied over a range of 3 in on each side of the center line of the strut. It should be added that the strain values given in figure 2 were those obtained from the lower set of strain gages, since they yielded a more consistent relationship than the top gages.

The departure of the calibration curve from the straight line predicted by eq (7) may possibly be accounted for by the nonhomogeneous nature of the welded steel tube used in fabricating the strut, and the possible presence of slight irregu-

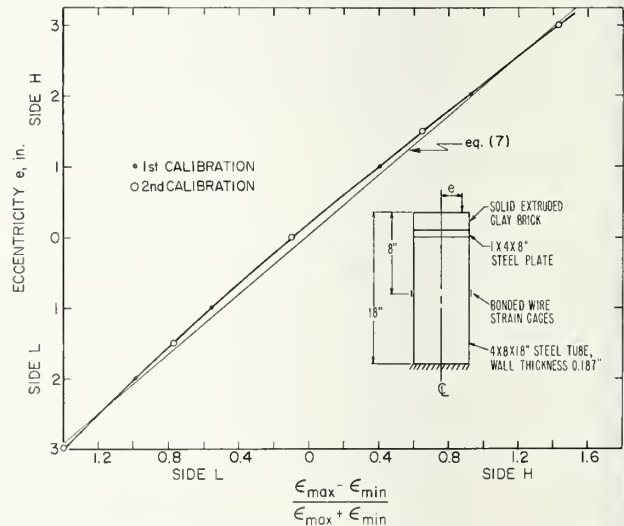


FIGURE 2. Calibration of reaction strut in terms of eccentricity.

$$(e \text{ vs. } \frac{\epsilon_{\max} - \epsilon_{\min}}{\epsilon_{\max} + \epsilon_{\min}})$$

larities commonly found in thin walled extruded steel shapes. In future work, it is intended to fabricate a strut of greater strain sensitivity and

have it relatively free from the deficiencies which might have caused the deviation from theoretical relationship shown in figure 2.

3. Eccentricity of Reaction of an I-Beam Bedded in Gypsum Plaster

One series of five tests was carried out with an I-beam 6 in deep and a flange 3½ in wide bedded in high strength gypsum plaster. As in all determinations of eccentricity described in this paper, the end of the I-beam extended to the center line of the supporting strut. The arrangement of supports and the load are shown in figure 3, along with the device for measuring the rotation of the beam end at the strut. This measurement was an approximation based on the assumption that the strut did not depart from its initial vertical position, and that the vertical displacement of the point at which the micrometer dial assembly was attached to the I-beam was negligible.

In Tests 1 and 2 the I-beam was bedded in unbonded plaster. The bond between the plaster and the bearing surfaces was destroyed by confining the plaster putty between two sheets of polyethylene. The variation of the eccentricity ratio with the rotation of the beam end is illustrated in figure 4. It is noted that at small rotations of the beam supported on the strut simulating a wall, the eccentricity ratio e/t^1 was about 0.35, or nearly the value usually assumed in design of masonry walls. The eccentricity ratio increased with the rotation of the beam and tended to reach a constant value at large rotations. For Tests 1 and 2, the maximum values of e/t were 0.43 and

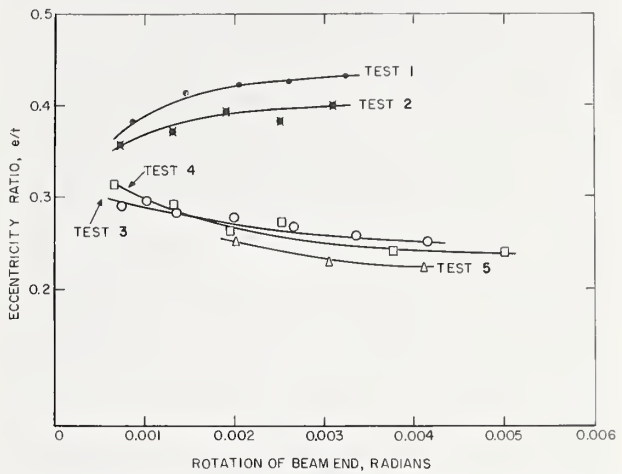


FIGURE 4. Eccentricity of reaction for an I-beam bedded in gypsum plaster. Tests 1 and 2—unbonded plaster; Tests 3, 4, and 5—bonded plaster, spans 24, 36, and 48 in, respectively.

0.40 respectively, with an average of 0.415. The maximum center load applied in these tests was 25 kips and the beam span was 44 inches.

In Tests 3, 4, and 5 the I-beam was bedded in bonded plaster and the span lengths were 24, 36 and 48 inches respectively. It is interesting to compare in figure 4 the effect of bonded and unbonded plaster bearings on the behavior of the I-beam. The unbonded I-beam showed an increase in the eccentricity ratio with load, while that for the bonded I-beam showed the opposite. The value of e/t for the bonded I-beam was about 0.32 for low loads and decreased with the rotation of the beam; the eccentricity ratio tended to reach a constant value as the rotation increased. The average e/t for the three tests at the maximum recorded rotation was about 0.24, and represents a reduction of 42% as compared with the eccentricity ratio for unbonded plaster.

Although the use of high strength gypsum plaster is not practical as a permanent bedding material for floor beams, its effect as a bonding bearing material was investigated as one phase of the broad problem of load transfer to masonry walls. It is possible that some other more permanent bedding material can be found which would have the same favorable effect on the eccentricity ratio as the high strength gypsum plaster.

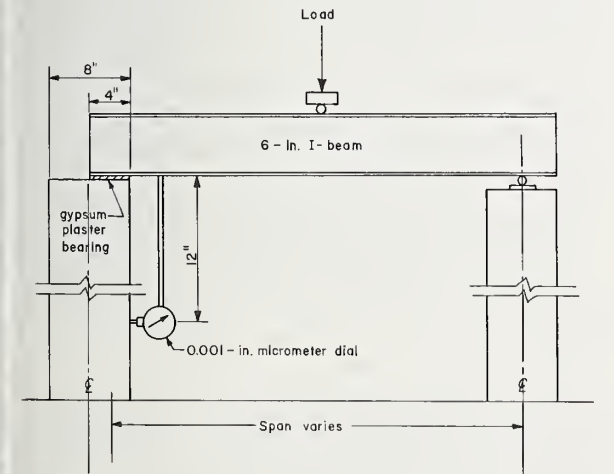


FIGURE 3. Schematic diagram of test set-up for an I-beam bedded in gypsum plaster.

¹ t is defined as the overall thickness of the strut.

4. Eccentricity of Reaction of an I-Beam Supported on Neoprene Rubber

Five tests were performed to determine the eccentricity ratio for the previously described I-beam supported on a neoprene rubber pad. The hardness of the rubber as given by Shore A. Durometer was 65 (instantaneous value). The rubber sheets were $\frac{1}{16}$ in thick and they were stacked to give thicknesses of $\frac{1}{8}$ and $\frac{1}{4}$ in.

The test setup used in the tests with a rubber bearing material was similar to that shown in figure 3, except that the rotation of the beam end was measured with two micrometer dial gages; one of these was clamped to the web of the I-beam and measured the movement of the end of the beam with respect to the bearing surface of the strut, while the second one was attached to the side of the strut and its stem was in contact with the underside of the flange of the I-beam.

In Tests 6 and 7 the I-beam was supported on a neoprene pad $\frac{1}{8}$ in thick over its entire 4-in bearing length. The rubber pad was coated with gypsum plaster putty on both bearing surfaces in order to assure intimate contact over its entire area.

The values of e/t obtained in Tests 6 and 7 are shown in figure 5. It is noted that e/t increased with the beam end rotation as would be expected in the case of an unbonded bearing which leaves the beam end free to rotate without any restraint

from the supporting wall. The average value of e/t ranged from 0.27 initially to 0.30 at the maximum rotation. The beam span used in these tests was 44 in and the maximum applied load was 30 kips.

Tests 6 and 7 were two independent determinations representing as nearly as possible identical support conditions. It is important to note that in spite of all efforts to secure uniform and intimate contact with the rubber bearing pad, the two determinations of e/t varied from 0.28 to 0.31 at the maximum rotation. Perhaps this variability even between two supposedly identical tests will account for the very large difference in e/t values between Test 10 and Tests 6 and 7. In Test 10 the carefully leveled I-beam was set directly on a rubber pad $\frac{1}{8}$ in thick; however, it was noted that the contact with the rubber pad was not intimate, and that daylight could be seen under the outer corners of the I-beam flange. In this instance a large rotation was observed at extremely small load. In this test the value of e/t was initially 0.45 and it tended to become nearly constant at 0.40 for the maximum rotation of the beam end. The span length in this test was 44 in and the maximum applied load was 30 kips. This comparison of otherwise identical tests (Tests 6, 7, and 10) points up the importance of attaining intimate contact with rubber pads of limited thickness and large bearing area. It can be seen that the e/t ratio of 0.40 for Test 10 was about the same as for unbonded plaster bearing pads in figure 4.

In Tests 8 and 9 the length of the bearing pad was reduced to 2 in at the extreme end of the beam. As would be expected, the confinement of the bearing reduced the e/t ratio considerably. For Test 8, with a capped bearing pad $\frac{1}{8}$ in thick, e/t ranged from an initial value of 0.17 to 0.185 at the maximum end rotation. For Test 9 in which the rubber pad thickness was increased to $\frac{1}{4}$ in and no plaster capping, the e/t ratio was further reduced to yield a maximum of about 0.15. It is noted that in this test the minimum value of e/t was 0.135, as compared with a theoretical value of 0.125. This theoretical value would be expected from the assumption that the centroid of the bearing stresses lies at the midpoint of a uniformly compressed pad.

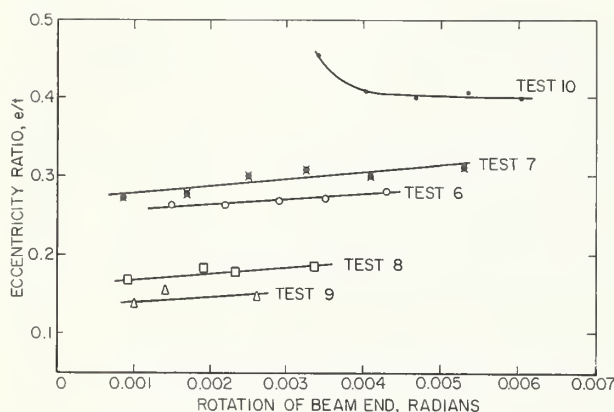


FIGURE 5. Eccentricity of reaction for an I-beam supported on neoprene rubber pads. Tests 6 and 7— $\frac{1}{8}$ in rubber pad 4 in long, coated with plaster; Test 8— $\frac{1}{8}$ in pad, 2 in long, coated with plaster; Test 9— $\frac{1}{4}$ in pad, 2 in long, no plaster; Test 10—same as 6 and 7, but no plaster coating.

5. Eccentricity of Supporting Force at the Base of a Bearing Wall Subjected to an Eccentrically Applied Load

Two exploratory tests were performed to investigate the feasibility of measuring the eccentricity of the supporting force at the base of a wall subjected to an eccentrically applied load. An overall view and a closeup of the loading fixture are shown in figures 6 and 7.

The wall used in these tests was essentially a pier $3\frac{3}{8}$ by $7\frac{7}{8}$ inches in cross section built of

solid extruded clay brick laid in stacked bond with extremely thin joints of high strength gypsum plaster. The strut was used as a base for this assembly, as shown in figure 6. The wall was built in two stages—the first was 24 in high and the second was 48 in high; both dimensions are nominal. The wall was subjected to two loads at each height, a centrally applied load, and an

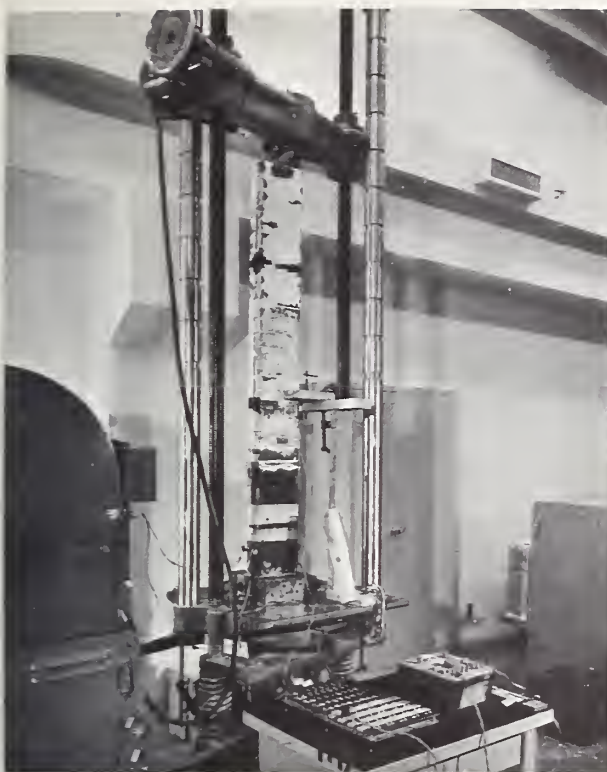


FIGURE 6. Overall view of test setup to determine the eccentricity of supporting force at the base of an eccentrically loaded bearing wall.

eccentric load applied on side H (see fig. 1) 2.5 in from the center line of the pier.² The values of eccentricity of applied loads and the measured values of eccentricity of reactions at the base of the wall are given in table 1 for both the 24- and 48-in heights of wall.

It can be seen from the data in table 1 that the calibrated reaction strut can be used to measure the eccentricity of the reaction at the base of a bearing wall. The effect of the height of the wall on the possible decrease of eccentricity at the base will be further explored in future tests using a calibrated reaction strut of sufficient capacity to accommodate a larger wall specimen.

The following comments appear appropriate to summarize the work reported herein:

1. A test procedure was developed by means of which the eccentricity of loads applied to a strut assumed to simulate a bearing wall could be measured. The device also was suitable for measuring the eccentricity of the supporting force at the base of a bearing wall subjected to an eccentric load.

² The center line of the pier was taken as the center line of the compressive strut.



FIGURE 7. Closeup of eccentrically loaded wall showing the loading knife edge.

TABLE 1. Measured eccentricities of reaction at the base of wall subjected to a load of known eccentricity

Wall height	Eccentricity of applied load	Applied load	Measured strains on strut		$\epsilon_{\max} - \epsilon_{\min}$	Measured eccentricity at base of wall (from fig. 2)
			ϵ_{\max}	ϵ_{\min}	$\epsilon_{\max} + \epsilon_{\min}$	
in	in	kips	10^{-6}	10^{-6}		in
24	0	15	112	112	0	0.15
24	0	20	151	149	.007	.16
24	2.5	10	155	¹ -10	1.14	2.45
48	0	10	69	77	-.05	0.06
48	0	20	148	159	-.04	.06
48	2.5	5	83	0	1.00	2.20
48	2.5	10	157	2	0.97	2.14

¹ Tensile strain.

6. Summary

2. Both rigid and resilient bearing materials such as gypsum plaster and neoprene rubber were used to support an I-beam as a floor member.

3. For an unbonded plaster bearing, the observed eccentricity ratio increased with rotation of the beam end to a maximum value of about 0.42. For the bonded plaster bearing this ratio decreased with rotation to an average value of 0.24 at the maximum load.

4. Intimacy of contact was essential for achieving a favorable distribution of bearing stresses

with a neoprene rubber pad. Lack of intimate and complete contact between the I-beam and the rubber pad resulted in an eccentricity ratio of about 0.40; this value was reduced to 0.29 by bedding the rubber pad in plaster. A 50 percent reduction of the bearing length of the pad and its confinement to the extreme end of the beam further reduced the eccentricity ratio to a minimum value of 0.135.

5. The eccentricity ratio was not found to be sensitive to substantial increases in the rotation of the beam end in the loading range producing rotations on the order of 0.004–0.005 rad.

6. Because of the limited sensitivity of the eccentricity measuring device, the values of eccentricity ratio observed for low loads and extremely

small rotations were not considered sufficiently accurate for presentation.

7. Because of the limitation of the span lengths and flexural rigidities of the floor beam and the reaction strut used in these tests, the eccentricity ratios reported herein may not be applicable to spans and rigidities of widely different values. It is considered that additional experimental work with greater range of parameters is needed.

8. In order to achieve a greater degree of similitude between the eccentricity measuring device and an actual masonry wall, the boundary conditions with respect to sidesway at the top and restraint at the base of the strut will need to be observed both during calibration and the measurement of eccentricities.

NBS TECHNICAL PUBLICATIONS

PERIODICALS

JOURNAL OF RESEARCH reports National Bureau of Standards research and development in physics, mathematics, chemistry, and engineering. Comprehensive scientific papers give complete details of the work, including laboratory data, experimental procedures, and theoretical and mathematical analyses. Illustrated with photographs, drawings, and charts.

Published in three sections, available separately:

● Physics and Chemistry

Papers of interest primarily to scientists working in these fields. This section covers a broad range of physical and chemical research, with major emphasis on standards of physical measurement, fundamental constants, and properties of matter. Issued six times a year. Annual subscription: Domestic, \$5.00; foreign, \$6.00*.

● Mathematical Sciences

Studies and compilations designed mainly for the mathematician and theoretical physicist. Topics in mathematical statistics, theory of experiment design, numerical analysis, theoretical physics and chemistry, logical design and programming of computers and computer systems. Short numerical tables. Issued quarterly. Annual subscription: Domestic, \$2.25; foreign, \$2.75*.

● Engineering and Instrumentation

Reporting results of interest chiefly to the engineer and the applied scientist. This section includes many of the new developments in instrumentation resulting from the Bureau's work in physical measurement, data processing, and development of test methods. It will also cover some of the work in acoustics, applied mechanics, building research, and cryogenic engineering. Issued quarterly. Annual subscription: Domestic, \$2.75; foreign, \$3.50*.

TECHNICAL NEWS BULLETIN

The best single source of information concerning the Bureau's research, developmental, cooperative and publication activities, this monthly publication is designed for the industry-oriented individual whose daily work involves intimate contact with science and technology—for *engineers, chemists, physicists, research managers, product-development managers, and company executives*. Annual subscription: Domestic, \$1.50; foreign, \$2.25*.

*Difference in price is due to extra cost of foreign mailing.

NONPERIODICALS

Applied Mathematics Series. Mathematical tables, manuals, and studies.

Building Science Series. Research results, test methods, and performance criteria of building materials, components, systems, and structures.

Handbooks. Recommended codes of engineering and industrial practice (including safety codes) developed in cooperation with interested industries, professional organizations, and regulatory bodies.

Special Publications. Proceedings of NBS conferences, bibliographies, annual reports, wall charts, pamphlets, etc.

Monographs. Major contributions to the technical literature on various subjects related to the Bureau's scientific and technical activities.

National Standard Reference Data Series. NSRDS provides quantitative data on the physical and chemical properties of materials, compiled from the world's literature and critically evaluated.

Product Standards. Provide requirements for sizes, types, quality and methods for testing various industrial products. These standards are developed cooperatively with interested Government and industry groups and provide the basis for common understanding of product characteristics for both buyers and sellers. Their use is voluntary.

Technical Notes. This series consists of communications and reports (covering both other agency and NBS-sponsored work) of limited or transitory interest.

CLEARINGHOUSE

The Clearinghouse for Federal Scientific and Technical Information, operated by NBS, supplies unclassified information related to Government-generated science and technology in defense, space, atomic energy, and other national programs. For further information on Clearinghouse services, write:

Clearinghouse
U.S. Department of Commerce
Springfield, Virginia 22151

Order NBS publications from:
Superintendent of Documents
Government Printing Office
Washington, D.C. 20402



**Announcement of New Publications in
Building Science Series**

Superintendent of Documents,
Government Printing Office,
Washington, D.C., 20402

Dear Sir:

Please add my name to the announcement list of new publications to be issued in the series: National Bureau of Standards Building Science Series.

Name _____

Company _____

Address _____

City _____ State _____ Zip Code _____

(Notification key N-339)

(cut here)



THE NATIONAL BUREAU OF STANDARDS

The National Bureau of Standards¹ provides measurement and technical information services essential to the efficiency and effectiveness of the work of the Nation's scientists and engineers. The Bureau serves also as a focal point in the Federal Government for assuring maximum application of the physical and engineering sciences to the advancement of technology in industry and commerce. To accomplish this mission, the Bureau is organized into three institutes covering broad program areas of research and services:

THE INSTITUTE FOR BASIC STANDARDS . . . provides the central basis within the United States for a complete and consistent system of physical measurements, coordinates that system with the measurement systems of other nations, and furnishes essential services leading to accurate and uniform physical measurements throughout the Nation's scientific community, industry, and commerce. This Institute comprises a series of divisions, each serving a classical subject matter area:

—Applied Mathematics—Electricity—Metrology—Mechanics—Heat—Atomic Physics—Physical Chemistry—Radiation Physics—Laboratory Astrophysics²—Radio Standards Laboratory,² which includes Radio Standards Physics and Radio Standards Engineering—Office of Standard Reference Data.

THE INSTITUTE FOR MATERIALS RESEARCH . . . conducts materials research and provides associated materials services including mainly reference materials and data on the properties of materials. Beyond its direct interest to the Nation's scientists and engineers, this Institute yields services which are essential to the advancement of technology in industry and commerce. This Institute is organized primarily by technical fields:

—Analytical Chemistry—Metallurgy—Reactor Radiations—Polymers—Inorganic Materials—Cryogenics²—Office of Standard Reference Materials.

THE INSTITUTE FOR APPLIED TECHNOLOGY . . . provides technical services to promote the use of available technology and to facilitate technological innovation in industry and government. The principal elements of this Institute are:

—Building Research—Electronic Instrumentation—Technical Analysis—Center for Computer Sciences and Technology—Textile and Apparel Technology Center—Office of Weights and Measures—Office of Engineering Standards Services—Office of Invention and Innovation—Office of Vehicle Systems Research—Clearinghouse for Federal Scientific and Technical Information³—Materials Evaluation Laboratory—NBS/GSA Testing Laboratory.

¹ Headquarters and Laboratories at Gaithersburg, Maryland, unless otherwise noted; mailing address Washington, D. C., 20234.

² Located at Boulder, Colorado, 80302.

³ Located at 5285 Port Royal Road, Springfield, Virginia 22151.

U.S. DEPARTMENT OF COMMERCE
WASHINGTON, D.C. 20230

OFFICIAL BUSINESS

POSTAGE AND FEES PAID
U.S. DEPARTMENT OF COMMERCE